

PHOTOVOLTAIC ARRAY DATA

MODULE MANUFACTURER: _____

MODULE MODEL: _____

OF PARALLEL CIRCUITS (STRINGS): _____

NOTE: INCLUDE DATA SHEET(S) WITH PROPOSAL

INVERTER DATA

INVERTER MANUFACTURER: _____

INVERTER MODEL: _____

NOTE: INCLUDE DATA SHEET(S) WITH PROPOSAL

SERVICE PANEL RATINGS


AMPS = _____ A

VOLTAGE = _____ V

MAIN BREAKER RATING = _____ A

P.V. BREAKER RATING = _____ A

FOR OFFICE USE ONLY

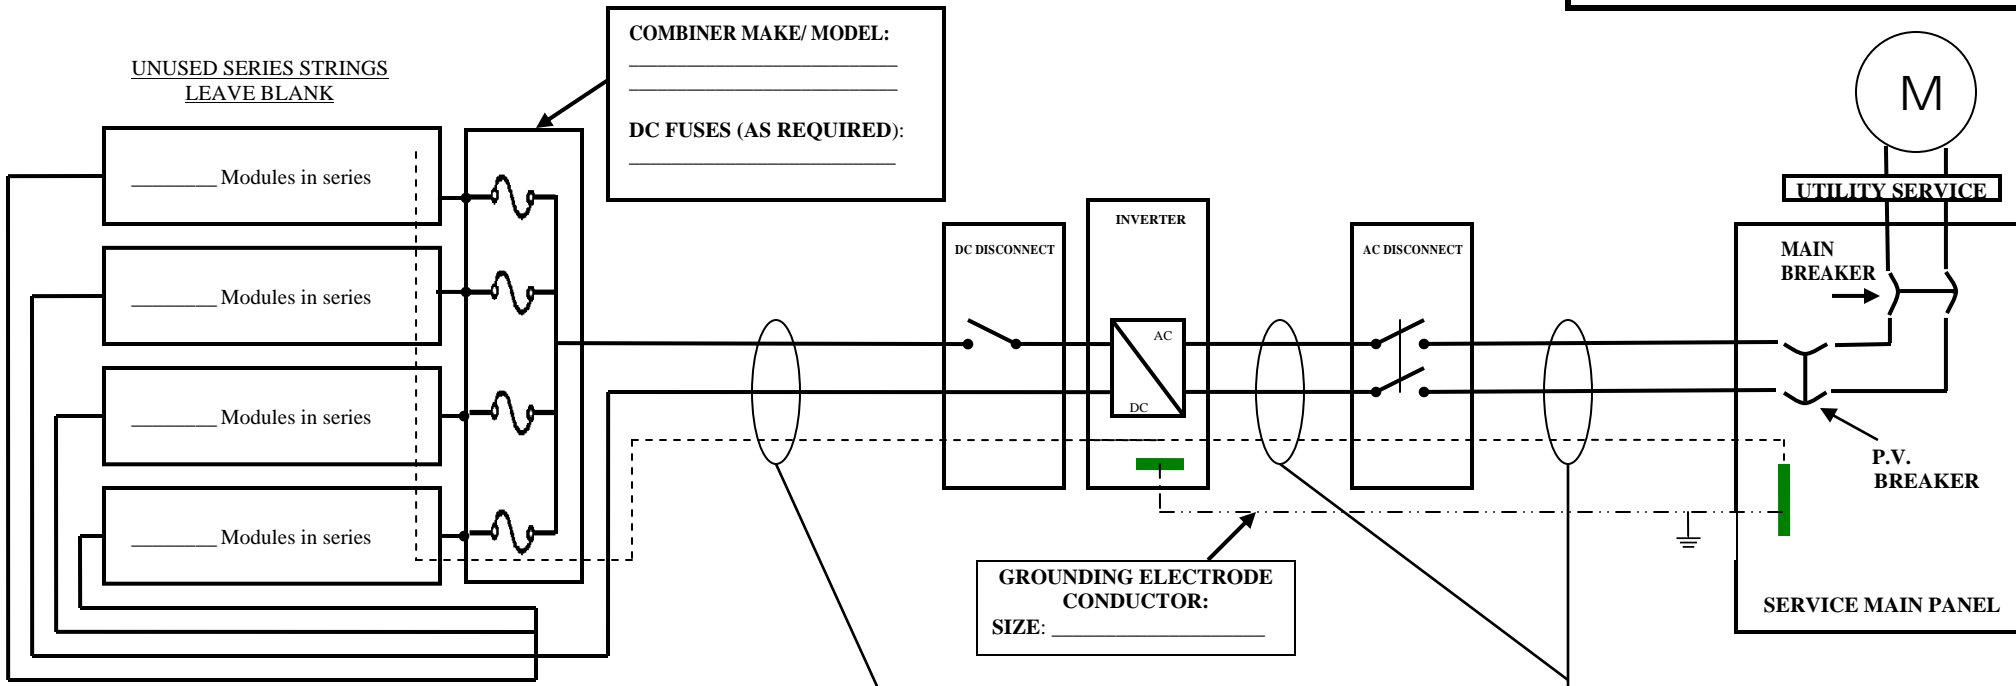

UNUSED SERIES STRINGS
LEAVE BLANK

COMBINER MAKE/ MODEL:

DC FUSES (AS REQUIRED):

GROUNDING ELECTRODE
CONDUCTOR:
SIZE: _____

UTILITY SERVICE
M
MAIN BREAKER
P.V. BREAKER
SERVICE MAIN PANEL

NOTES

1. Plans must be followed exactly as approved.
2. All grounded conductors #6 and smaller must comply with NEC 200.6
3. All ground mounted arrays require footing inspections in compliance with approved plans.

CONDUCTORS-INDICATE SIZE AND TYPE:
UNGROUND: _____
GROUNDED: _____
EQUIP. GRND: _____

CONDUIT:
SIZE: _____
TYPE: _____

CONDUCTORS-INDICATE SIZE AND TYPE:
UNGROUND: _____
GROUNDED: _____
EQUIP. GRND: _____

CONDUIT:
SIZE: _____
TYPE: _____

NAME: _____
ADDRESS: _____
CONTRACTOR: _____
DAYTIME PH. #: _____
E-MAIL: _____

An E-Mail address is requested to aid in resolving any questions that might arise. Most issues will be able to be resolved electronically.